



COBALT
GEOSCIENCES

**Geotechnical Investigation
Proposed Commercial
Development**

8833 Soper Hill Road
Lake Stevens, Washington

December 19, 2019

Table of Contents

1.0 INTRODUCTION	1
2.0 PROJECT DESCRIPTION	1
3.0 SITE DESCRIPTION	1
4.0 FIELD INVESTIGATION	2
4.1.1 Site Investigation Program	2

5.0 SOIL AND GROUNDWATER CONDITIONS	2
5.1.1 Area Geology	2
5.1.2 Groundwater	3

6.0 GEOLOGIC HAZARDS	3
6.1 Erosion Hazard	3
6.2 Seismic Hazard	3

7.0 DISCUSSION	4
7.1.1 General.....	4

8.0 RECOMMENDATIONS	4
8.1.1 Site Preparation	4
8.1.2 Temporary Excavations.....	4
8.1.3 Erosion and Sediment Control.....	5
8.1.4 Foundation Design	6
8.1.5 Retaining Walls	7
8.1.6 Stormwater Management	8
8.1.7 Slab-on-Grade	8
8.1.8 Groundwater Influence on Construction	9
8.1.9 Utilities	9
8.1.10 Pavements.....	10

9.0 CONSTRUCTION FIELD REVIEWS	11
10.0 CLOSURE	11

LIST OF APPENDICES

Appendix A — Statement of General Conditions
Appendix B — Figures
Appendix C — Exploration Logs

December 19, 2019

1.0 Introduction

In accordance with your authorization, Cobalt Geosciences, LLC (Cobalt) has completed a geotechnical investigation for the proposed commercial development located at 8833 Soper Hill Road in Lake Stevens, Washington (Figure 1).

The purpose of the geotechnical investigation was to identify subsurface conditions and to provide geotechnical recommendations for foundation design, stormwater management, earthwork, soil compaction, and suitability of the on-site soils for use as fill.

The scope of work for the geotechnical evaluation consisted of a site investigation followed by engineering analyses to prepare this report. Recommendations presented herein pertain to various geotechnical aspects of the proposed development, including foundation support of the new buildings, detention vaults, and new pavements.

2.0 Project Description

The project includes construction of new commercial buildings, parking areas, drive lanes, and landscaped areas. Associated construction will include stormwater infrastructure and utilities. The number of buildings, building locations, and elevations has not been finalized.

Anticipated building loads are expected to be light to moderate and site grading will include cuts and fills on the order of 12 feet or less. Stormwater management will likely include one or more detention systems. We should be provided with the final plans when they become available.

3.0 Site Description

The site is located at 8833 Soper Hill Road in Lake Stevens, Washington (Figure 1). The property consists of two irregularly shaped parcels (No.'s 00590700031800 & 00590700030500) with a total area of about 15.75 acres.

The southeast portion of the property is developed with a residence and numerous outbuildings and slabs. There is a driveway that accesses the property from the south. The remainder of the property is undeveloped and appears to be utilized as an agricultural field. Vegetation consists of blackberry vines, grasses, and very sparse trees. There are high tension power lines that extend north to south across the eastern edge of the property. There are local glacial erratics (boulders) within the field areas.

The site slopes gently downward from north to the southeast and southwest from the north-central portion of the property. Slope magnitudes range from 5 to 15 percent with total relief of about 25 feet.

The site is bordered to the north by residential properties, to the south by Soper Hill Road, to the east by vacant land and SR 9, and to the west by 87th Avenue NE.

December 19, 2019

4.0 Field Investigation

4.1.1 Site Investigation Program

The geotechnical field investigation program was completed on December 12, 2019 and included excavating and sampling 12 test pits within the property for subsurface analysis.

The soils encountered were logged in the field and are described in accordance with the Unified Soil Classification System (USCS).

A Cobalt Geosciences field representative conducted the explorations, collected disturbed soil samples, classified the encountered soils, kept a detailed log of the explorations, and observed and recorded pertinent site features.

The results of the sampling are presented on the exploration logs enclosed in Appendix C.

5.0 Soil and Groundwater Conditions

5.1.1 Area Geology

The site lies within the Puget Lowland. The lowland is part of a regional north-south trending trough that extends from southwestern British Columbia to near Eugene, Oregon. North of Olympia, Washington, this lowland is glacially carved, with a depositional and erosional history including at least four separate glacial advances/retreats. The Puget Lowland is bounded to the west by the Olympic Mountains and to the east by the Cascade Range. The lowland is filled with glacial and non-glacial sediments consisting of interbedded gravel, sand, silt, till, and peat lenses.

The Geologic Map of Washington – Northwest Quadrant, indicates that the site is underlain by Vashon Glacial Till.

Vashon Glacial Till is typically characterized by an unsorted, non-stratified mixture of clay, silt, sand, gravel, cobbles and boulders in variable quantities. These materials are typically dense and relatively impermeable. The poor sorting reflects the mixing of the materials as these sediments were overridden and incorporated by the glacial ice.

Explorations

All of the test pits encountered approximately 6 to 12 inches of topsoil and vegetation underlain by approximately 2 to 5 feet of loose to medium dense, silty-fine to medium grained sand with gravel trace cobbles (Weathered Glacial Till). These deposits were underlain by dense to very dense, silty-fine to medium grained sand with gravel trace cobbles (Glacial Till), which continued to the termination depths of the test pits. Areas of poorly graded sand were encountered in TP-11 between 3.5 and 6 feet below grade.

December 19, 2019

5.1.2 Groundwater

Groundwater was encountered in TP-1, TP-4, TP-6, and TP-9 through TP-11 at 1.5 to 6 feet below grade. Groundwater was perched between weathered and unweathered glacial till. The zone of groundwater was generally less than 8 inches thick except for TP-11, which was about 2.5 feet thick.

Water table elevations often fluctuate over time. The groundwater level will depend on a variety of factors that may include seasonal precipitation, irrigation, land use, climatic conditions and soil permeability. Water levels at the time of the field investigation may be different from those encountered during the construction phase of the project.

6.0 Geologic Hazards

6.1 Erosion Hazard

The Natural Resources Conservation Services (NRCS) maps for Snohomish County indicate that the site is underlain by Tokul gravelly medial loam (0 to 8 percent slopes). These soils would have a slight to moderate erosion potential in a disturbed state, depending on the slope magnitude.

It is our opinion that soil erosion potential at this project site can be reduced through landscaping and surface water runoff control. Typically erosion of exposed soils will be most noticeable during periods of rainfall and may be controlled by the use of normal temporary erosion control measures, such as silt fences, hay bales, mulching, control ditches and diversion trenches. The typical wet weather season, with regard to site grading, is from October 31st to April 1st. Erosion control measures should be in place before the onset of wet weather.

6.2 Seismic Hazard

The overall subsurface profile corresponds to a Site Class *D* as defined by Table 1613.5.2 of the 2015 International Building Code (2015 IBC). A Site Class *D* applies to an overall profile consisting of dense to very dense soils within the upper 100 feet.

We referenced the U.S. Geological Survey (USGS) Earthquake Hazards Program Website to obtain values for S_s , S_l , F_a , and F_v . The USGS website includes the most updated published data on seismic conditions. The site specific seismic design parameters and adjusted maximum spectral response acceleration parameters are as follows:

PGA	(Peak Ground Acceleration, in percent of g)
S_s	113.80% of g
S_l	43.90% of g
F_A	1.045
F_V	1.561

December 19, 2019

Additional seismic considerations include liquefaction potential and amplification of ground motions by soft/loose soil deposits. The liquefaction potential is highest for loose sand with a high groundwater table. The relatively dense soil deposits that underlie the site have a low liquefaction potential.

7.0 DISCUSSION

7.1.1 General

The site is underlain by weathered and unweathered glacial till. The proposed commercial buildings may be supported on shallow foundation systems bearing on medium dense or firmer native soils or on structural fill placed on suitable native soils. The depth to bearing soils varied from 2 to 3.5 feet in our test pits.

Infiltration is not feasible at this site. The underlying soils consist of fine grained glacial till, which is not conducive to infiltration of stormwater runoff.

8.0 Recommendations

8.1.1 Site Preparation

Trees, shrubs and other vegetation should be removed prior to stripping of surficial organic-rich soil and fill. Based on observations from the site investigation program, it is anticipated that the stripping depth will be 6 to 18 inches. Deeper excavations will be necessary below large trees and in any areas underlain by undocumented fill materials.

The native soils consist of silty-sand with gravel. These soils may be used as structural fill provided they achieve compaction requirements and are within 3 percent of the optimum moisture. Some of these soils may only be suitable for use as fill during the summer months, as they will be above the optimum moisture levels in their current state. These soils are variably moisture sensitive and may degrade during periods of wet weather and under equipment traffic.

Imported structural fill should consist of a sand and gravel mixture with a maximum grain size of 3 inches and less than 5 percent fines (material passing the U.S. Standard No. 200 Sieve). Structural fill should be placed in maximum lift thicknesses of 12 inches and should be compacted to a minimum of 95 percent of the modified proctor maximum dry density, as determined by the ASTM D 1557 test method.

8.1.2 Temporary Excavations

Based on our understanding of the project, we anticipate that the grading could include local cuts on the order of approximately 12 feet or less for detention vault and utility placement. Excavations should be sloped no steeper than 1H:1V in medium dense native and fill soils and 3/4H:1V in dense to very dense native soils. If an excavation is subject to heavy vibration or surcharge loads, we recommend that the excavations be sloped no steeper than 1.5H:1V, where room permits.

December 19, 2019

Temporary cuts should be in accordance with the Washington Administrative Code (WAC) Part N, Excavation, Trenching, and Shoring. Temporary slopes should be visually inspected daily by a qualified person during construction activities and the inspections should be documented in daily reports. The contractor is responsible for maintaining the stability of the temporary cut slopes and reducing slope erosion during construction.

Temporary cut slopes should be covered with visqueen to help reduce erosion during wet weather, and the slopes should be closely monitored until the permanent retaining systems or slope configurations are complete. Materials should not be stored or equipment operated within 10 feet of the top of any temporary cut slope.

Soil conditions may not be completely known from the geotechnical investigation. In the case of temporary cuts, the existing soil conditions may not be completely revealed until the excavation work exposes the soil. Typically, as excavation work progresses the maximum inclination of temporary slopes will need to be re-evaluated by the geotechnical engineer so that supplemental recommendations can be made. Soil and groundwater conditions can be highly variable. Scheduling for soil work will need to be adjustable, to deal with unanticipated conditions, so that the project can proceed and required deadlines can be met.

If any variations or undesirable conditions are encountered during construction, we should be notified so that supplemental recommendations can be made. If room constraints or groundwater conditions do not permit temporary slopes to be cut to the maximum angles allowed by the WAC, temporary shoring systems may be required. The contractor should be responsible for developing temporary shoring systems, if needed. We recommend that Cobalt Geosciences and the project structural engineer review temporary shoring designs prior to installation, to verify the suitability of the proposed systems.

8.1.3 Erosion and Sediment Control

Erosion and sediment control (ESC) is used to reduce the transportation of eroded sediment to wetlands, streams, lakes, drainage systems, and adjacent properties. Erosion and sediment control measures should be implemented and these measures should be in general accordance with local regulations. At a minimum, the following basic recommendations should be incorporated into the design of the erosion and sediment control features for the site:

- Schedule the soil, foundation, utility, and other work requiring excavation or the disturbance of the site soils, to take place during the dry season (generally May through September). However, provided precautions are taken using Best Management Practices (BMP's), grading activities can be completed during the wet season (generally October through April).
- All site work should be completed and stabilized as quickly as possible.
- Additional perimeter erosion and sediment control features may be required to reduce the possibility of sediment entering the surface water. This may include additional silt fences, silt fences with a higher Apparent Opening Size (AOS), construction of a berm, or other filtration systems.
- Any runoff generated by dewatering discharge should be treated through construction of a sediment trap if there is sufficient space. If space is limited other filtration methods will need to be incorporated.

December 19, 2019

8.1.4 Foundation Design

The proposed commercial buildings may be supported on shallow spread footing foundation systems bearing on undisturbed medium dense or firmer native soils or on properly compacted structural fill placed on the suitable native soils. If structural fill is used to support foundations, then the zone of structural fill should extend beyond the faces of the footing a lateral distance at least equal to the thickness of the structural fill.

For shallow foundation support, we recommend widths of at least 18 and 24 inches, respectively, for continuous wall and isolated column footings supporting the proposed structures. Provided that the footings are supported as recommended above, a net allowable bearing pressure of 3,000 pounds per square foot (psf) may be used for design. Detention vaults or any structures with footing elevations at least 6 feet below existing site elevations may be designed using an allowable bearing pressure of 5,000 psf.

A 1/3 increase in the above value may be used for short duration loads, such as those imposed by wind and seismic events. Structural fill placed on bearing, native subgrade should be compacted to at least 95 percent of the maximum dry density based on ASTM Test Method D1557. Footing excavations should be inspected to verify that the foundations will bear on suitable material.

Exterior footings should have a minimum depth of 18 inches below pad subgrade (soil grade) or adjacent exterior grade, whichever is lower. Interior footings should have a minimum depth of 12 inches below pad subgrade (soil grade) or adjacent exterior grade, whichever is lower.

If constructed as recommended, the total foundation settlement is not expected to exceed 1 inch. Differential settlement, along a 25-foot exterior wall footing, or between adjoining column footings, should be less than 1/2 inch. This translates to an angular distortion of 0.002. Most settlement is expected to occur during construction, as the loads are applied. However, additional post-construction settlement may occur if the foundation soils are flooded or saturated. All footing excavations should be observed by a qualified geotechnical consultant.

Resistance to lateral footing displacement can be determined using an allowable friction factor of 0.35 acting between the base of foundations and the supporting subgrades. Lateral resistance for footings can also be developed using an allowable equivalent fluid passive pressure of 250 pounds per cubic foot (pcf) acting against the appropriate vertical footing faces (neglect the upper 12 inches below grade in exterior areas).

The allowable friction factor and allowable equivalent fluid passive pressure values include a factor of safety of 1.5. The frictional and passive resistance of the soil may be combined without reduction in determining the total lateral resistance.

Care should be taken to prevent wetting or drying of the bearing materials during construction. Any extremely wet or dry materials, or any loose or disturbed materials at the bottom of the footing excavations, should be removed prior to placing concrete. The potential for wetting or drying of the bearing materials can be reduced by pouring concrete as soon as possible after completing the footing excavation and evaluating the bearing surface by the geotechnical engineer or his representative.

December 19, 2019

8.1.5 Reinforced Concrete Retaining Walls

The following table, titled **Wall Design Criteria**, presents the recommended soil related design parameters for retaining walls with a level backslope. This information is provided for use in below-grade vault construction, if proposed. Contact Cobalt if an alternate retaining wall system is used.

Wall Design Criteria	
“At-rest” Conditions (Lateral Earth Pressure – EFD ⁺)	55 pcf (Equivalent Fluid Density)
“Active” Conditions (Lateral Earth Pressure – EFD ⁺)	35 pcf (Equivalent Fluid Density)
Seismic Increase for “At-rest” Conditions (Lateral Earth Pressure)	12H* (Uniform Distribution)
Seismic Increase for “Active” Conditions (Lateral Earth Pressure)	6H* (Uniform Distribution)
Passive Earth Pressure on Low Side of Wall (Allowable, includes F.S. = 1.5)	Neglect upper 2 feet, then 300 pcf EFD ⁺
Soil-Footing Coefficient of Sliding Friction (Allowable; includes F.S. = 1.5)	0.40

*H is the height of the wall; Increase based on one in 500 year seismic event (10 percent probability of being exceeded in 50 years),
+ EFD – Equivalent Fluid Density

The stated lateral earth pressures do not include the effects of hydrostatic pressure generated by water accumulation behind the retaining walls. Uniform horizontal lateral active and at-rest pressures on the retaining walls from vertical surcharges behind the wall may be calculated using active and at-rest lateral earth pressure coefficients of 0.3 and 0.5, respectively. The soil unit weight of 125 pcf may be used to calculate vertical earth surcharges.

To reduce the potential for the buildup of water pressure against the walls, continuous footing drains (with cleanouts) should be provided at the bases of the walls. The footing drains should consist of a minimum 4-inch diameter perforated pipe, sloped to drain, with perforations placed down and enveloped by a minimum 6 inches of pea gravel in all directions.

The backfill adjacent to and extending a lateral distance behind the walls at least 2 feet should consist of free-draining granular material. All free draining backfill should contain less than 3 percent fines (passing the U.S. Standard No. 200 Sieve) based upon the fraction passing the U.S. Standard No. 4 Sieve with at least 30 percent of the material being retained on the U.S. Standard No. 4 Sieve. The primary purpose of the free-draining material is the reduction of hydrostatic pressure. Some potential for the moisture to contact the back face of the wall may exist, even with treatment, which may require that more extensive waterproofing be specified for walls, which require interior moisture sensitive finishes.

December 19, 2019

We recommend that the backfill be compacted to at least 90 percent of the maximum dry density based on ASTM Test Method D1557. In place density tests should be performed to verify adequate compaction. Soil compactors place transient surcharges on the backfill. Consequently, only light hand operated equipment is recommended within 3 feet of walls so that excessive stress is not imposed on the walls.

8.1.6 Stormwater Management

The site is underlain by weathered and unweathered glacial till. Infiltration is typically not feasible in glacial till. At this site, we encountered dense to very dense glacial till at shallow depths. Groundwater was encountered between weathered and unweathered glacial till in several of the test pits. It is our opinion that infiltration is not feasible at the site. The glacial till acts as a restrictive layer that does not allow vertical infiltration. Groundwater was present locally and will likely be present throughout the site at shallow depths. There is inadequate clearance above groundwater for any shallow infiltration system.

We anticipate that one or more below-grade detention vaults will be utilized for stormwater management. We should be provided with final plans for review to determine if the intent of our recommendations has been incorporated or if additional modifications are needed. We can provide additional recommendations upon request.

8.1.7 Slab-on-Grade

We recommend that the upper 12 inches of the existing fill and/or native soils within slab areas be re-compacted to at least 95 percent of the modified proctor (ASTM D1557 Test Method). Locally deeper excavations may be necessary if unstable fill soils are present. A geotextile or geogrid may be necessary to bridge underlying fill. A geotechnical consultant should provide site specific recommendations during construction.

Often, a vapor barrier is considered below concrete slab areas. However, the usage of a vapor barrier could result in curling of the concrete slab at joints. Floor covers sensitive to moisture typically requires the usage of a vapor barrier. A materials or structural engineer should be consulted regarding the detailing of the vapor barrier below concrete slabs. Exterior slabs typically do not utilize vapor barriers.

The American Concrete Institutes ACI 360R-06 Design of Slabs on Grade and ACI 302.1R-04 Guide for Concrete Floor and Slab Construction are recommended references for vapor barrier selection and floor slab detailing.

Slabs on grade may be designed using a coefficient of subgrade reaction of 180 pounds per cubic inch (pci) assuming the slab-on-grade base course is underlain by structural fill placed and compacted as outlined in Section 8.1. Capillary break should be placed over the prepared subgrade and consist of at least 4 inches of clean angular rock or pea gravel.

A perimeter drainage system is recommended unless interior slab areas are elevated a minimum of 12 inches above adjacent exterior grades. If installed, a perimeter drainage system should consist of a 4 inch diameter perforated drain pipe surrounded by a minimum 6 inches of drain rock wrapped in a non-woven geosynthetic filter fabric to reduce migration of soil particles into the drainage system. The perimeter drainage system should discharge by gravity flow to a suitable stormwater system.

December 19, 2019

Exterior grades surrounding buildings should be sloped at a minimum of one percent to facilitate surface water flow away from the building and preferably with a relatively impermeable surface cover immediately adjacent to the building.

8.1.8 Groundwater Influence on Construction

Groundwater was encountered in TP-1, TP-4, TP-6, and TP-9 through TP-11 at 1.5 to 6 feet below grade. Groundwater was perched between weathered and unweathered glacial till. The zone of groundwater was generally less than 8 inches thick except for TP-11, which was about 2.5 feet thick. Groundwater should be expected during winter and spring months throughout the site. The depth

If groundwater is encountered, we anticipate that sump excavations and small diameter pumps systems will adequately de-water short-term excavations, if required. Any system should be designed by the contractor. We can provide additional recommendations upon request.

8.1.9 Utilities

Utility trenches should be excavated according to accepted engineering practices following OSHA (Occupational Safety and Health Administration) standards, by a contractor experienced in such work. The contractor is responsible for the safety of open trenches. Traffic and vibration adjacent to trench walls should be reduced; cyclic wetting and drying of excavation side slopes should be avoided. Depending upon the location and depth of some utility trenches, groundwater flow into open excavations could be experienced, especially during or shortly following periods of precipitation.

In general, silty soils were encountered at shallow depths in the explorations at this site. These soils have low cohesion and density and will have a tendency to cave or slough in excavations. Shoring or sloping back trench sidewalls is required within these soils in excavations greater than 4 feet deep.

All utility trench backfill should consist of imported structural fill or suitable on site soils. Utility trench backfill placed in or adjacent to buildings and exterior slabs should be compacted to at least 95 percent of the maximum dry density based on ASTM Test Method D1557. The upper 5 feet of utility trench backfill placed in pavement areas should be compacted to at least 95 percent of the maximum dry density based on ASTM Test Method D1557. Below 5 feet, utility trench backfill in pavement areas should be compacted to at least 90 percent of the maximum dry density based on ASTM Test Method D1557. Pipe bedding should be in accordance with the pipe manufacturer's recommendations.

The contractor is responsible for removing all water-sensitive soils from the trenches regardless of the backfill location and compaction requirements. Depending on the depth and location of the proposed utilities, we anticipate the need to re-compact existing fill soils below the utility structures and pipes. The contractor should use appropriate equipment and methods to avoid damage to the utilities and/or structures during fill placement and compaction procedures.

December 19, 2019

8.1.10 Pavement Recommendations

The near surface subgrade soils generally consist of silty sand with gravel. These soils are rated as good for pavement subgrade material (depending on silt content and moisture conditions). We estimate that the subgrade will have a California Bearing Ratio (CBR) value of 10 and a modulus of subgrade reaction value of $k = 200$ pci, provided the subgrade is prepared in general accordance with our recommendations.

We recommend that at a minimum, 12 inches of the existing subgrade material be moisture conditioned (as necessary) and re-compacted to prepare for the construction of pavement sections. Deeper levels of recompaction or overexcavation and replacement may be necessary in areas where fill and/or very poor (soft/loose) soils are present. Any soils that cannot be compacted to required levels and soils that have more than 40 percent fines by weight should be removed and replaced with imported structural fill.

The geotechnical engineer can provide location-specific recommendations during construction. It should be noted that earthwork taking place during the wet season will likely increase the need to overexcavate and replace fill materials.

The subgrade should be compacted to at least 95 percent of the maximum dry density as determined by ASTM Test Method D1557. In place density tests should be performed to verify proper moisture content and adequate compaction.

The recommended flexible and rigid pavement sections are based on design CBR and modulus of subgrade reaction (k) values that are achieved, only following proper subgrade preparation. It should be noted that subgrade soils that have relatively high silt contents will likely be highly sensitive to moisture conditions. The subgrade strength and performance characteristics of a silty subgrade material may be dramatically reduced if this material becomes wet.

Based on our knowledge of the proposed project, we expect the traffic to range from light duty (passenger automobiles) to heavy duty (delivery trucks). The following tables show the recommended pavement sections for light duty and heavy duty use.

ASPHALTIC CONCRETE (FLEXIBLE) PAVEMENT

LIGHT DUTY

Asphaltic Concrete	Aggregate Base*	Compacted Subgrade* **
2.5 in.	6.0 in.	12.0 in.

HEAVY DUTY

Asphaltic Concrete	Aggregate Base*	Compacted Subgrade* **
3.5 in.	6.0 in.	12.0 in.

December 19, 2019

PORTLAND CEMENT CONCRETE (RIGID) PAVEMENT

Min. PCC Depth	Aggregate Base*	Compacted Subgrade* **
6.0 in.	6.0 in.	12.0 in.

* 95% compaction based on ASTM Test Method D1557

** A proof roll may be performed in lieu of in place density tests

The asphaltic concrete depth in the flexible pavement tables should be a surface course type asphalt, such as Washington Department of Transportation (WSDOT) 1/2 inch HMA. The rigid pavement design is based on a Portland Cement Concrete (PCC) mix that has a 28 day compressive strength of 4,000 pounds per square inch (psi). The design is also based on a concrete flexural strength or modulus of rupture of 550 psi.

9.0 Construction Field Reviews

Cobalt Geosciences should be retained to provide part time field review during construction in order to verify that the soil conditions encountered are consistent with our design assumptions and that the intent of our recommendations is being met. This will require field and engineering review to:

- Monitor and test structural fill placement and soil compaction
- Observe bearing capacity at foundation locations
- Observe slab-on-grade preparation
- Observe pavement subgrade stability
- Monitor subgrade preparation of roadways
- Observe excavation stability

Geotechnical design services should also be anticipated during the subsequent final design phase to support the structural design and address specific issues arising during this phase. Field and engineering review services will also be required during the construction phase in order to provide a Final Letter for the project.

10.0 Closure

This report was prepared for the exclusive use of Natural 9 Holdings and their appointed consultants. Any use of this report or the material contained herein by third parties, or for other than the intended purpose, should first be approved in writing by Cobalt Geosciences, LLC.

The recommendations contained in this report are based on assumed continuity of soils with those of our test holes, and assumed structural loads. Cobalt Geosciences should be provided with final architectural and civil drawings when they become available in order that we may review our design recommendations and advise of any revisions, if necessary.

**GEOTECHNICAL INVESTIGATION
LAKE STEVENS, WASHINGTON**




December 19, 2019

Use of this report is subject to the Statement of General Conditions provided in Appendix A. It is the responsibility of Natural 9 Holdings, LLC who is identified as “the Client” within the Statement of General Conditions, and its agents to review the conditions and to notify Cobalt Geosciences should any of these not be satisfied.

Respectfully submitted,

Cobalt Geosciences, LLC

Original signed by:

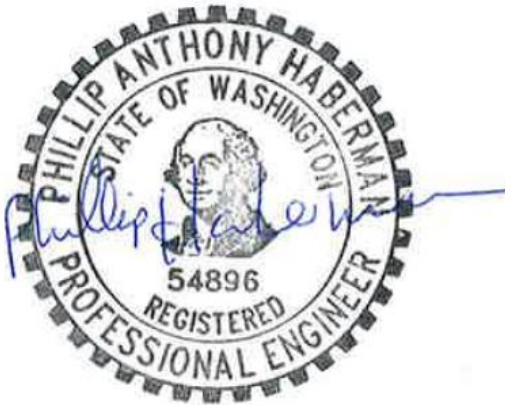

Exp. 6/26/2020

Phil Haberman, PE, LG, LEG
Principal

PH/sc

APPENDIX A
Statement of General Conditions

Statement of General Conditions

USE OF THIS REPORT: This report has been prepared for the sole benefit of the Client or its agent and may not be used by any third party without the express written consent of Cobalt Geosciences and the Client. Any use which a third party makes of this report is the responsibility of such third party.

BASIS OF THE REPORT: The information, opinions, and/or recommendations made in this report are in accordance with Cobalt Geosciences present understanding of the site specific project as described by the Client. The applicability of these is restricted to the site conditions encountered at the time of the investigation or study. If the proposed site specific project differs or is modified from what is described in this report or if the site conditions are altered, this report is no longer valid unless Cobalt Geosciences is requested by the Client to review and revise the report to reflect the differing or modified project specifics and/or the altered site conditions.


STANDARD OF CARE: Preparation of this report, and all associated work, was carried out in accordance with the normally accepted standard of care in the state of execution for the specific professional service provided to the Client. No other warranty is made.

INTERPRETATION OF SITE CONDITIONS: Soil, rock, or other material descriptions, and statements regarding their condition, made in this report are based on site conditions encountered by Cobalt Geosciences at the time of the work and at the specific testing and/or sampling locations. Classifications and statements of condition have been made in accordance with normally accepted practices which are judgmental in nature; no specific description should be considered exact, but rather reflective of the anticipated material behavior. Extrapolation of in situ conditions can only be made to some limited extent beyond the sampling or test points. The extent depends on variability of the soil, rock and groundwater conditions as influenced by geological processes, construction activity, and site use.

VARYING OR UNEXPECTED CONDITIONS: Should any site or subsurface conditions be encountered that are different from those described in this report or encountered at the test locations, Cobalt Geosciences must be notified immediately to assess if the varying or unexpected conditions are substantial and if reassessments of the report conclusions or recommendations are required. Cobalt Geosciences will not be responsible to any party for damages incurred as a result of failing to notify Cobalt Geosciences that differing site or sub-surface conditions are present upon becoming aware of such conditions.

PLANNING, DESIGN, OR CONSTRUCTION: Development or design plans and specifications should be reviewed by Cobalt Geosciences, sufficiently ahead of initiating the next project stage (property acquisition, tender, construction, etc), to confirm that this report completely addresses the elaborated project specifics and that the contents of this report have been properly interpreted. Specialty quality assurance services (field observations and testing) during construction are a necessary part of the evaluation of sub-subsurface conditions and site preparation works. Site work relating to the recommendations included in this report should only be carried out in the presence of a qualified geotechnical engineer; Cobalt Geosciences cannot be responsible for site work carried out without being present.

APPENDIX B
Figures: Vicinity Map, Site Plan

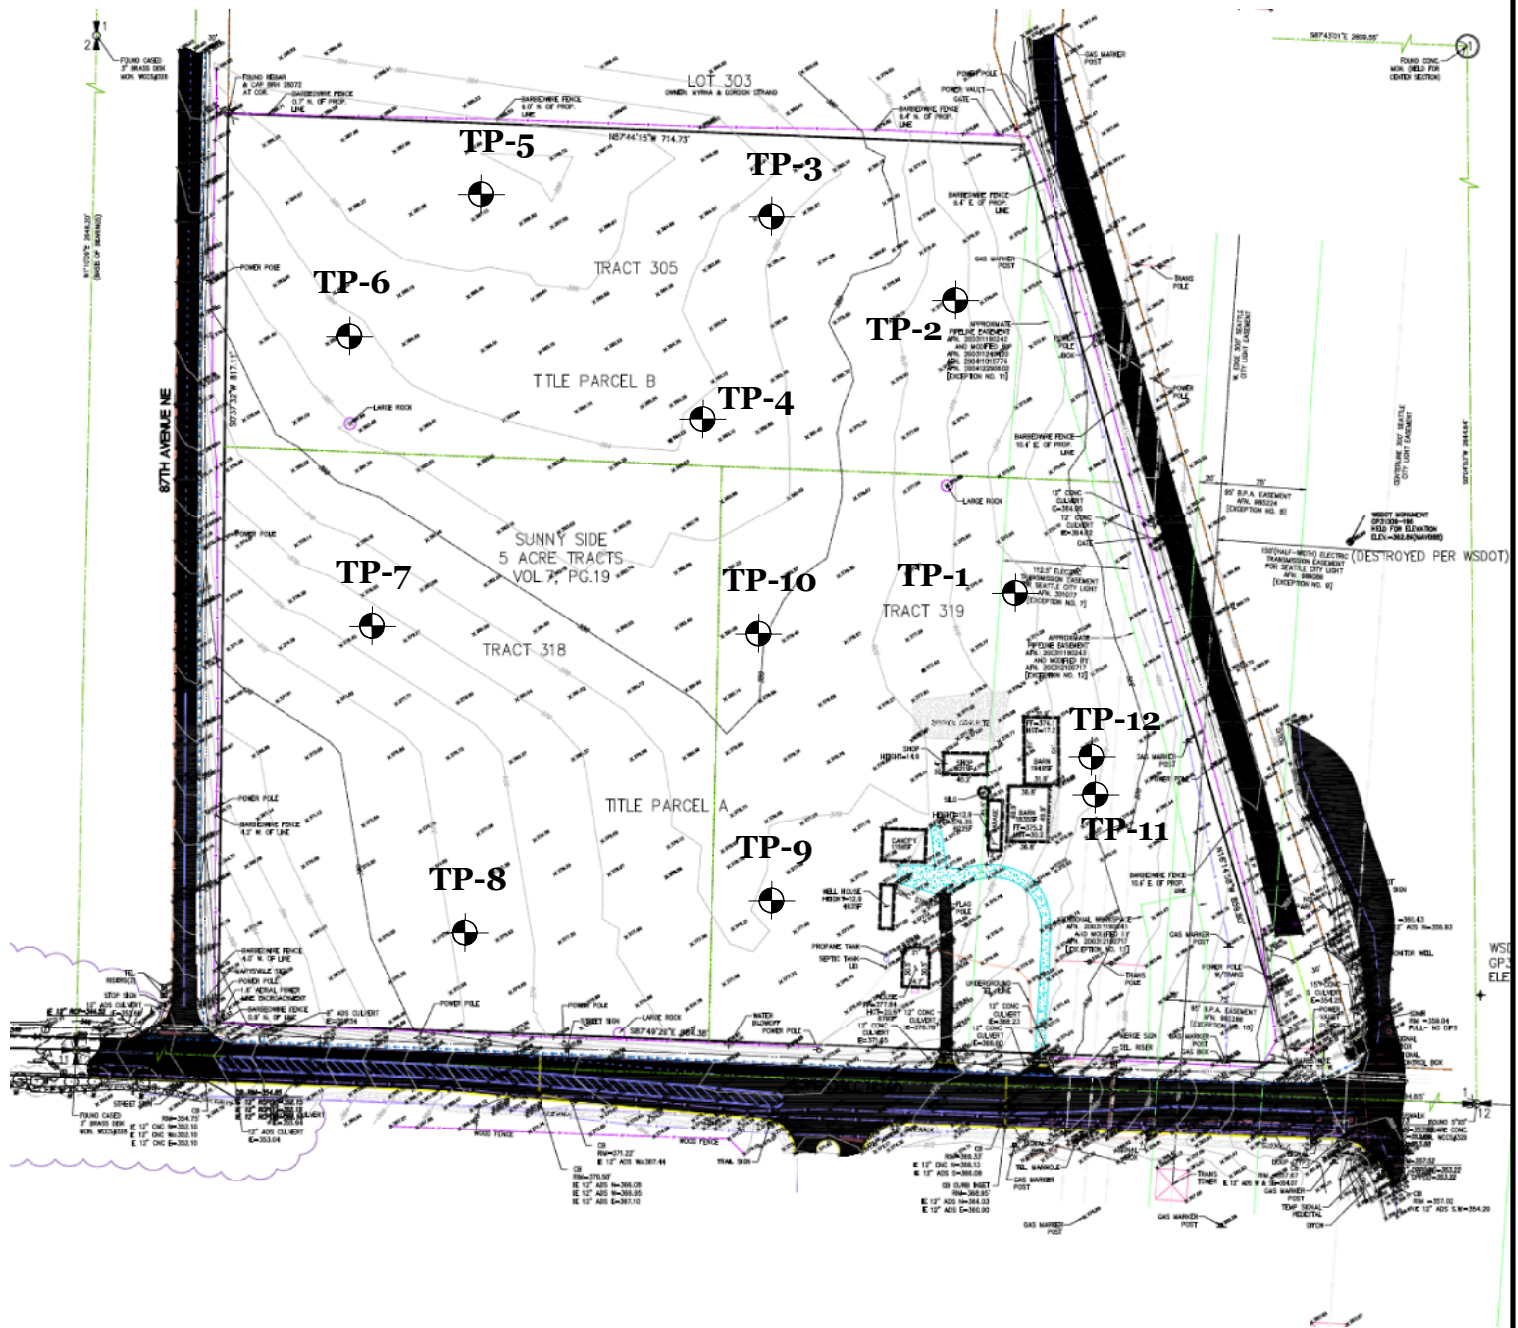

TP-1 **Approximate
Test Pit
Location**



Not to Scale



Proposed Commercial Development
8833 Soper Hill Road
Lake Stevens, Washington

SITE PLAN

FIGURE 2

Cobalt Geosciences, LLC
P.O. Box 82243
Kenmore, WA 98028
(206) 331-1097
www.cobaltgeo.com
cobaltgeo@gmail.com

APPENDIX C
Exploration Logs

Unified Soil Classification System (USCS)

MAJOR DIVISIONS			SYMBOL	TYPICAL DESCRIPTION	
COARSE GRAINED SOILS (more than 50% retained on No. 200 sieve)	Gravels (more than 50% of coarse fraction retained on No. 4 sieve)	Clean Gravels (less than 5% fines)	GW	Well-graded gravels, gravels, gravel-sand mixtures, little or no fines	
		Gravels with Fines (more than 12% fines)	GP	Poorly graded gravels, gravel-sand mixtures, little or no fines	
		Gravels with Fines (more than 12% fines)	GM	Silty gravels, gravel-sand-silt mixtures	
		Gravels with Fines (more than 12% fines)	GC	Clayey gravels, gravel-sand-clay mixtures	
	Sands (50% or more of coarse fraction passes the No. 4 sieve)	Clean Sands (less than 5% fines)	SW	Well-graded sands, gravelly sands, little or no fines	
		Sands with Fines (more than 12% fines)	SP	Poorly graded sand, gravelly sands, little or no fines	
		Sands with Fines (more than 12% fines)	SM	Silty sands, sand-silt mixtures	
		Sands with Fines (more than 12% fines)	SC	Clayey sands, sand-clay mixtures	
		Silts and Clays (liquid limit less than 50)	Inorganic	ML	Inorganic silts of low to medium plasticity, sandy silts, gravelly silts, or clayey silts with slight plasticity
			Inorganic	CL	Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays
Organic	OL		Organic silts and organic silty clays of low plasticity		
Silts and Clays (liquid limit 50 or more)	Inorganic		MH	Inorganic silts, micaceous or diatomaceous fine sands or silty soils, elastic silt	
	Inorganic	CH	Inorganic clays of medium to high plasticity, sandy fat clay, or gravelly fat clay		
	Organic	OH	Organic clays of medium to high plasticity, organic silts		
HIGHLY ORGANIC SOILS	Primarily organic matter, dark in color, and organic odor	PT	Peat, humus, swamp soils with high organic content (ASTM D4427)		

Classification of Soil Constituents
<p>MAJOR constituents compose more than 50 percent, by weight, of the soil. Major constituents are capitalized (i.e., SAND).</p> <p>Minor constituents compose 12 to 50 percent of the soil and precede the major constituents (i.e., silty SAND). Minor constituents preceded by "slightly" compose 5 to 12 percent of the soil (i.e., slightly silty SAND).</p> <p>Trace constituents compose 0 to 5 percent of the soil (i.e., slightly silty SAND, trace gravel).</p>

Grain Size Definitions	
Description	Sieve Number and/or Size
Fines	< #200 (0.08 mm)
Sand	#200 to #40 (0.08 to 0.4 mm)
-Fine	#40 to #10 (0.4 to 2 mm)
-Medium	#10 to #4 (2 to 5 mm)
-Coarse	
Gravel	#4 to 3/4 inch (5 to 19 mm)
-Fine	3/4 to 3 inches (19 to 76 mm)
-Coarse	
Cobbles	3 to 12 inches (75 to 305 mm)
Boulders	>12 inches (305 mm)

Relative Density (Coarse Grained Soils)		Consistency (Fine Grained Soils)	
N, SPT, Blows/FT	Relative Density	N, SPT, Blows/FT	Relative Consistency
0 - 4	Very loose	Under 2	Very soft
4 - 10	Loose	2 - 4	Soft
10 - 30	Medium dense	4 - 8	Medium stiff
30 - 50	Dense	8 - 15	Stiff
Over 50	Very dense	15 - 30	Very stiff
		Over 30	Hard

Moisture Content Definitions	
Dry	Absence of moisture, dusty, dry to the touch
Moist	Damp but no visible water
Wet	Visible free water, from below water table



Cobalt Geosciences, LLC
 P.O. Box 82243
 Kenmore, WA 98028
 (206) 331-1097
www.cobaltgeo.com
cobaltgeo@gmail.com

Soil Classification Chart

Figure C1

Test Pit TP-1

Date: December 12, 2019	Depth: 8'	Groundwater: 2.5 and 6'
Contractor: Client provided	Elevation:	Logged By: PH Checked By: SC

Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater	Moisture Content (%)					
						Plastic Limit	Liquid Limit				
						DCP Equivalent N-Value					
						0	10	20	30	40	50
		[Topsoil/veg symbol]		Topsoil/Vegetation							
2		[Sand symbol]	SM	Loose to medium dense, silty-fine to medium grained sand with gravel, mottled reddish brown to yell. brown, moist. (Weathered Glacial Till)	▼						
4		[Sand symbol]	SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)							
6	■				▼						
8	■										
10				-Trace cobbles							
12	■										
14											
16				End of Test Pit 16'							
18											
20											

Test Pit TP-2

Date: October 8, 2019	Depth: 8'	Groundwater: None
Contractor: Jim	Elevation:	Logged By: PH Checked By: SC

Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater	Moisture Content (%)					
						Plastic Limit	Liquid Limit				
						DCP Equivalent N-Value					
						0	10	20	30	40	50
		[Topsoil/veg symbol]		Topsoil/Vegetation							
1		[Sand symbol]	SM	Loose to medium dense, silty-fine to medium grained sand with gravel, mottled reddish brown to yellowish brown, moist. (Weathered Glacial Till)							
2		[Sand symbol]									
3	■										
4	■										
5		[Sand symbol]	SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)							
6	■										
7											
8				End of Test Pit 8'							
9											
10											



Proposed Development
8833 Soper Hill Road
Lake Stevens, Washington

**Test Pit
Logs**

Cobalt Geosciences, LLC
P.O. Box 82243
Kenmore, WA 98028
(206) 331-1097
www.cobaltgeo.com
cobaltgeo@gmail.com

Test Pit TP-3

Date: December 12, 2019		Depth: 8'		Groundwater: None	
Contractor: Client provided		Elevation:		Logged By: PH Checked By: SC	
Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater
					Moisture Content (%) Plastic Limit -----●----- Liquid Limit
					DCP Equivalent N-Value 0 10 20 30 40 50
1			SM	Topsail/Vegetation	
2			SM	Loose to medium dense, silty-fine to medium grained sand with gravel, mottled reddish brown to yellowish brown, moist. (Weathered Glacial Till)	
3			SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)	
4				-Trace cobbles	
5					
6					
7					
8				End of Test Pit 8'	
9					
10					

Test Pit TP-4

Date: October 8, 2019		Depth: 8'		Groundwater: 2.5'	
Contractor: Jim		Elevation:		Logged By: PH Checked By: SC	
Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater
					Moisture Content (%) Plastic Limit -----●----- Liquid Limit
					DCP Equivalent N-Value 0 10 20 30 40 50
1			SM	Topsail/Vegetation	
2			SM	Loose to medium dense, silty-fine to medium grained sand with gravel, mottled reddish brown to yellowish brown, moist. (Weathered Glacial Till)	▼
3			SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)	
4				-Trace cobbles	
5					
6					
7					
8				End of Test Pit 8'	
9					
10					



Proposed Development
8833 Soper Hill Road
Lake Stevens, Washington

**Test Pit
Logs**

Cobalt Geosciences, LLC
P.O. Box 82243
Kenmore, WA 98028
(206) 331-1097
www.cobaltgeo.com
cobaltgeo@gmail.com

Test Pit TP-5

Date: December 12, 2019		Depth: 8'		Groundwater: None'		
Contractor: Client provided		Elevation:		Logged By: PH Checked By: SC		
Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater	Moisture Content (%)
						DCP Equivalent N-Value
1				Topsail/Vegetation		
2			SM	Loose to medium dense, silty-fine to medium grained sand with gravel mottled reddish brown to yellowish brown, moist. (Weathered Glacial Till)		
3						
4			SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)		
5						
6				-Trace cobbles		
7						
8				End of Test Pit 8'		
9						
10						

Test Pit TP-6

Date: October 8, 2019		Depth: 8'		Groundwater: 2.5'		
Contractor: Jim		Elevation:		Logged By: PH Checked By: SC		
Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater	Moisture Content (%)
						DCP Equivalent N-Value
1				Topsail/Vegetation		
2			SM	Loose to medium dense, silty-fine to medium grained sand with gravel grayish brown, moist. (Weathered Glacial Till)		
3			SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)	▼	
4						
5						
6				-Trace cobbles		
7						
8				End of Test Pit 8'		
9						
10						



Proposed Development
8833 Soper Hill Road
Lake Stevens, Washington

**Test Pit
Logs**

Cobalt Geosciences, LLC
P.O. Box 82243
Kenmore, WA 98028
(206) 331-1097
www.cobaltgeo.com
cobaltgeo@gmail.com

Test Pit TP-7

Date: December 12, 2019		Depth: 8'		Groundwater: None'		
Contractor: Client provided		Elevation:		Logged By: PH Checked By: SC		
Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater	Moisture Content (%)
						DCP Equivalent N-Value
1			SM	Topssoil/Vegetation		
2			SM	Loose to medium dense, silty-fine to medium grained sand with gravel, mottled reddish brown to yellowish brown, moist. (Weathered Glacial Till)		
3						
4			SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)		
5						
6				-Trace cobbles		
7						
8				End of Test Pit 8'		
9						
10						

Test Pit TP-8

Date: October 8, 2019		Depth: 8'		Groundwater: None		
Contractor: Jim		Elevation:		Logged By: PH Checked By: SC		
Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater	Moisture Content (%)
						DCP Equivalent N-Value
1			SM	Topssoil/Vegetation		
2			SM	Loose to medium dense, silty-fine to medium grained sand with gravel, mottled reddish brown to yellowish brown, moist. (Weathered Glacial Till)		
3						
4			SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)		
5						
6				-Trace cobbles		
7						
8				End of Test Pit 8'		
9						
10						



Proposed Development
8833 Soper Hill Road
Lake Stevens, Washington

**Test Pit
Logs**


Cobalt Geosciences, LLC
P.O. Box 82243
Kenmore, WA 98028
(206) 331-1097
www.cobaltgeo.com
cobaltgeo@gmail.com

Test Pit TP-9

Date: December 12, 2019		Depth: 8'		Groundwater: 1.5'		
Contractor: Client provided		Elevation:		Logged By: PH Checked By: SC		
Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater	Moisture Content (%)
DCP Equivalent N-Value						
1				Topsail/Vegetation		
2			SM	Loose to medium dense, silty-fine to medium grained sand with gravel, mottled reddish brown to yellowish brown, moist. (Weathered Glacial Till)	▼	
3						
4			SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)		
5						
6				-Trace cobbles		
7						
8				End of Test Pit 8'		
9						
10						

Test Pit TP-10

Date: October 8, 2019		Depth: 8'		Groundwater: 1.5'		
Contractor: Jim		Elevation:		Logged By: PH Checked By: SC		
Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater	Moisture Content (%)
DCP Equivalent N-Value						
1				Topsail/Vegetation		
2			SM	Loose to medium dense, silty-fine to medium grained sand with gravel, mottled reddish brown to yellowish brown, moist. (Weathered Glacial Till)	▼	
3						
4			SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)		
5						
6				End of Test Pit 6'		
7						
8						
9						
10						

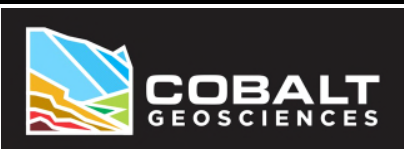

Proposed Development
8833 Soper Hill Road
Lake Stevens, Washington

**Test Pit
Logs**

Cobalt Geosciences, LLC
P.O. Box 82243
Kenmore, WA 98028
(206) 331-1097
www.cobaltgeo.com
cobaltgeo@gmail.com

Test Pit TP-11

Date: December 12, 2019		Depth: 8'		Groundwater: 3.5'		
Contractor: Client provided		Elevation:		Logged By: PH Checked By: SC		
Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater	Moisture Content (%)
						Plastic Limit -----●----- Liquid Limit
						DCP Equivalent N-Value
						0 10 20 30 40 50
1				Topsoil/Vegetation		
2			SM	Loose to medium dense, silty-fine to medium grained sand with gravel, yellowish brown, moist. (Weathered Glacial Till?)	▼	
3						
4				-Areas of poorly graded sand with gravel, very wet		
5						
6			SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)		
7						
8				End of Test Pit 8'		
9						
10						

Test Pit TP-12

Date: October 8, 2019		Depth: 6'		Groundwater: None		
Contractor: Jim		Elevation:		Logged By: PH Checked By: SC		
Depth (Feet)	Interval	Graphic Log	USCS Symbol	Material Description	Groundwater	Moisture Content (%)
						Plastic Limit -----●----- Liquid Limit
						DCP Equivalent N-Value
						0 10 20 30 40 50
1				Topsoil/Vegetation		
2			SM	Loose to medium dense, silty-fine to medium grained sand with gravel, mottled reddish brown to yellowish brown, moist. (Weathered Glacial Till)		
3						
4			SM	Dense to very dense, silty-fine to medium grained sand with gravel, grayish brown, moist. (Glacial Till)		
5						
6				End of Test Pit 6'		
7						
8						
9						
10						



Proposed Development
8833 Soper Hill Road
Lake Stevens, Washington

**Test Pit
Logs**

Cobalt Geosciences, LLC
P.O. Box 82243
Kenmore, WA 98028
(206) 331-1097
www.cobaltgeo.com
cobaltgeo@gmail.com